



## Liquefied Petroleum Gas

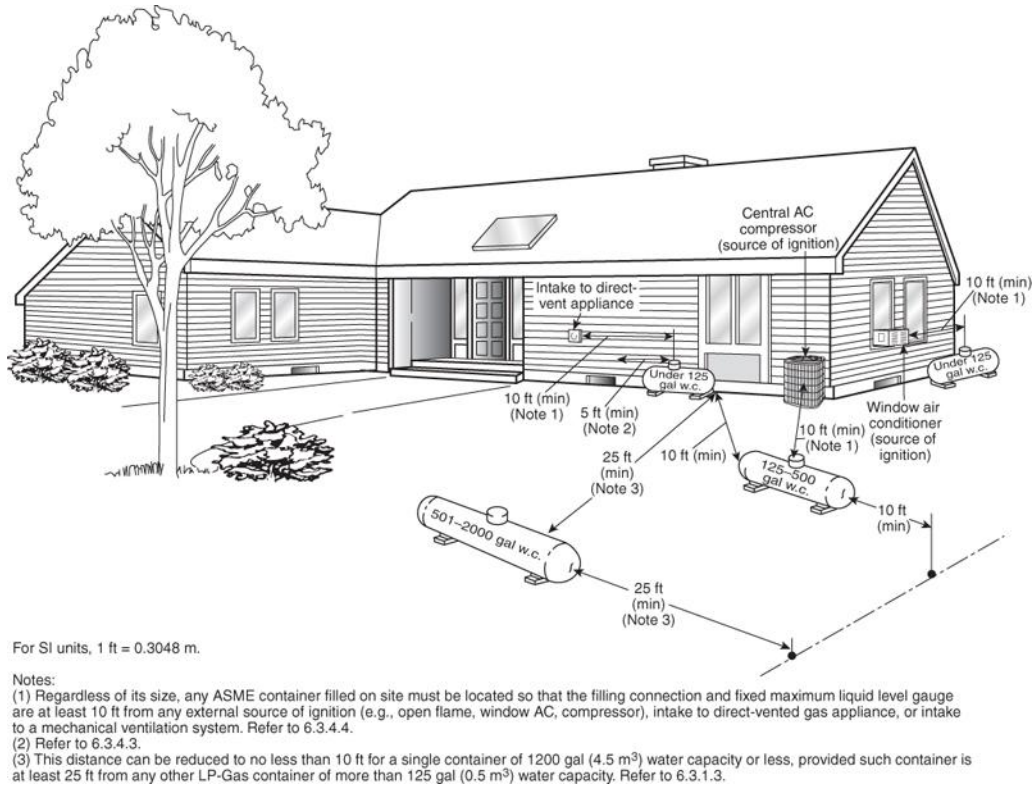


FIGURE I.1 (b) Aboveground ASME Containers. (This figure for illustration purposes only; written code shall govern)

**Clearance to Combustibles.** Weeds, grass, brush, trash and other combustible materials shall be kept a minimum of 10 Feet (3048 mm) from LP-gas tanks or containers.

**Vehicle Impact Protection.** Vehicle impact protection shall be provided by posts that comply with the following or by other approved physical barriers.

Guard posts shall comply with all of the following requirements:

1. Constructed of steel not less than 4 inches (102 mm) in diameter and concrete filled.
2. Spaced not more than 4 feet (1219 mm) between posts on center.
3. Set not less than 3 feet (914 mm) deep in a concrete footing of not less than a 15-inch (381 mm) diameter.
4. Set with the top of the posts not less than 3 feet (914 mm) above ground.
5. Located not less than 3 feet (914 mm) from the protected object.